



SLOPES FOR VARIABLE SUPER ELEVATION RATE
FOR STANDARD 2'-6" CURB AND GUTTER

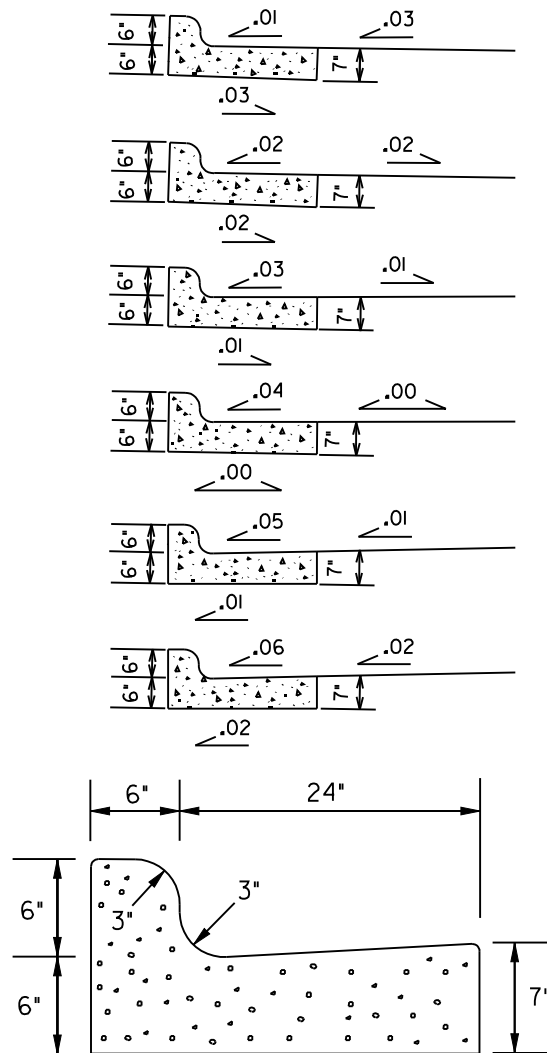

1. 30" CURB & GUTTER

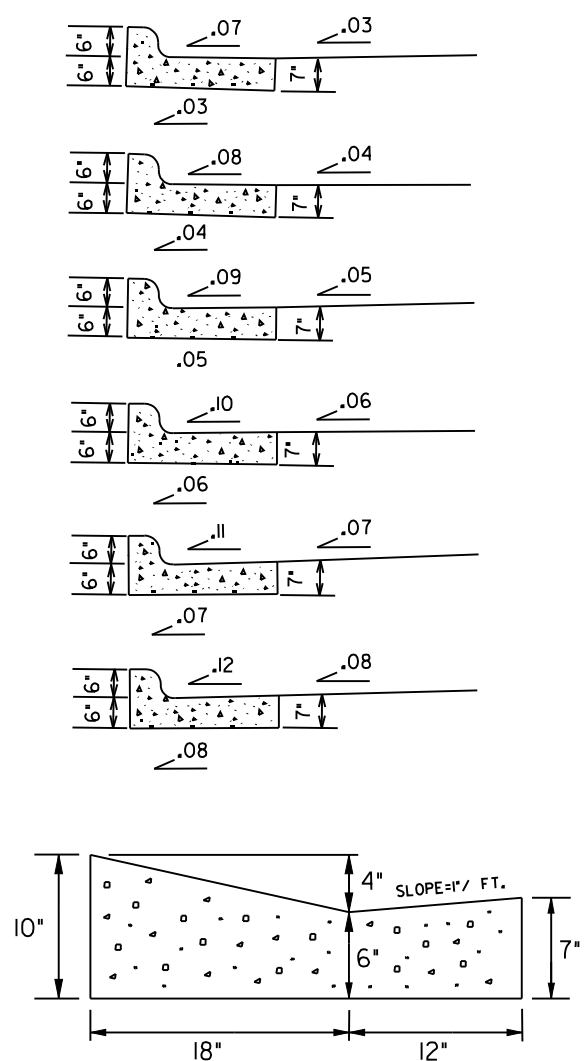

2. 30" VALLEY TYPE GUTTER

NOTES:

1. 10' MAXIMUM BETWEEN CONSTRUCTION JOINTS.
15' MAXIMUM BETWEEN CONSTRUCTION JOINTS
ON MACHINE POURS.
2. 1/2" EXPANSION JOINT EVERY 90'.
3. 3000 PSI CONCRETE MINIMUM, 4" SLUMP MAXIMUM.
4. LIQUID MEMBRANE CURING COMPOUND SHALL MEET
THE REQUIREMENTS OF SECTION 1026-2 OF NCDOT
STANDARDS & SPECIFICATIONS FOR ROADS AND
STRUCTURES.
5. ALL CONSTRUCTION JOINTS SHALL BE FILLED
WITH JOINT FILLER AND SEALER IN ACCORDANCE
WITH NCDOT ROADWAY STANDARD DETAIL 846.01.
THE JOINT MATERIAL SHALL CONFORM TO SECTION
1028-2 OF NCDOT'S STANDARD SPECIFICATIONS FOR
ROADS AND STRUCTURES.
6. ABC STONE REQUIRED UNDER ALL CURB & GUTTER.

SHEET 1 OF 2

CITY OF RALEIGH
PUBLIC WORKS DEPARTMENT

REVISIONS	DATE: 7/3/00	DRAWN BY: JTB
5/13/04 JTT	CURB AND GUTTERS	
6/5/06 JTT		
1/12/07 WDP		
5/31/07 JTT		
	STD. * 20.2 I	